OLIVEHURST PUBLIC UTILITY DISTRICT
MEMORANDUM

DATE : June 27, 2025

TO : John Tillotson, General Manager

FROM : Nicholas Pomeroy, Chief Plant Operator

RE: **Monthly Report of Activities for Board meeting on 7/17/2025**

- For the month of May the OPUD Wastewater Treatment Facility had no exceedances of its N.P.D.E.S. permit.
- The new Uniforms for the Waste Water department finally arrived on 4/30/25. There are still some employees who are missing the new shirts. As we get the complete uniforms in we will start getting updated photos for the OPUD website and new OPUD badges made.
- Plant Staff cleaned the filters and the UV system to keep both systems running efficiently.
- Rio Del Oro Lift station: Staff has been checking all equipment at Rio Del Oro lift station on a regular basis.
- Collection staff used the Vaccon to clean approximately 5,000ft of sewer lines. They also used the new CCTV system to inspect approximately 5,000ft of the sewer line.
- The Gold Village waste water plant has been running smoothly. There were no violations in May.
- The Hard Rock casino waste water plant has been running well. Staff has done a chlorine soak/clean on MBR 1 on 6-13-25 and will do the same for MBR 2 on 6-27-25.
- The OPUD Waste Water Plant processed during the month of May 60.09 million gallons, which is an average of 1.94 MGD flow.
- The Bar Screen at OPUD's WWTP is back online. I have received the quote from Saveco to complete a full rebuild of the Bar Screen and provided it to Swarnjit.
- Drying beds at the OPUD WWTP are continuing to be filled and processed as quickly as possible.
- The motor for the Grit Pump has been replaced due to the headworks flooding on May 4th from a power outage. The Grit Paddle drive motor also just got replaced. A new Battery Backup has been installed for the SCADA computer and callout system so if power is lost it will still notify whomever is on call.
- Staff replaced the seal on the South East Oxidation Aerator.

- Staff replaced the bad batteries on the cart used around the plant.
- At lift station 14 the discharge pipes for two of the three pumps have corroded and have a hole in them so we cannot use those 2 pumps currently.

South East Oxidation Ditch Aerator Seal replacement.

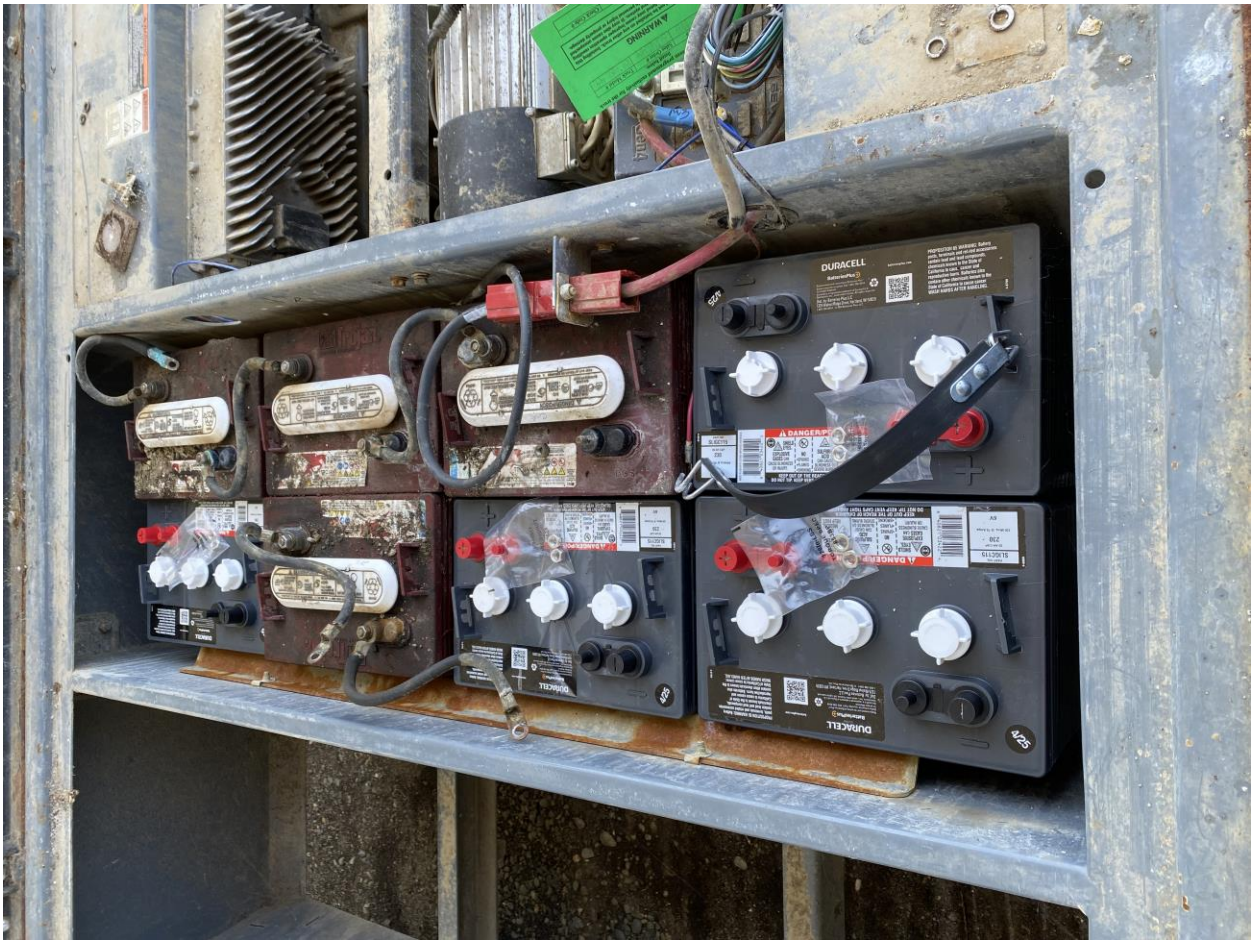

New batteries being installed in the cart at the OPUD WWTP

If you have any questions my contact info is below.

Nicholas Pomeroy
Chief Plant Operator
Olivehurst Public Utility District
Cell (530) 635-8113
email: npomeroy@opud.org